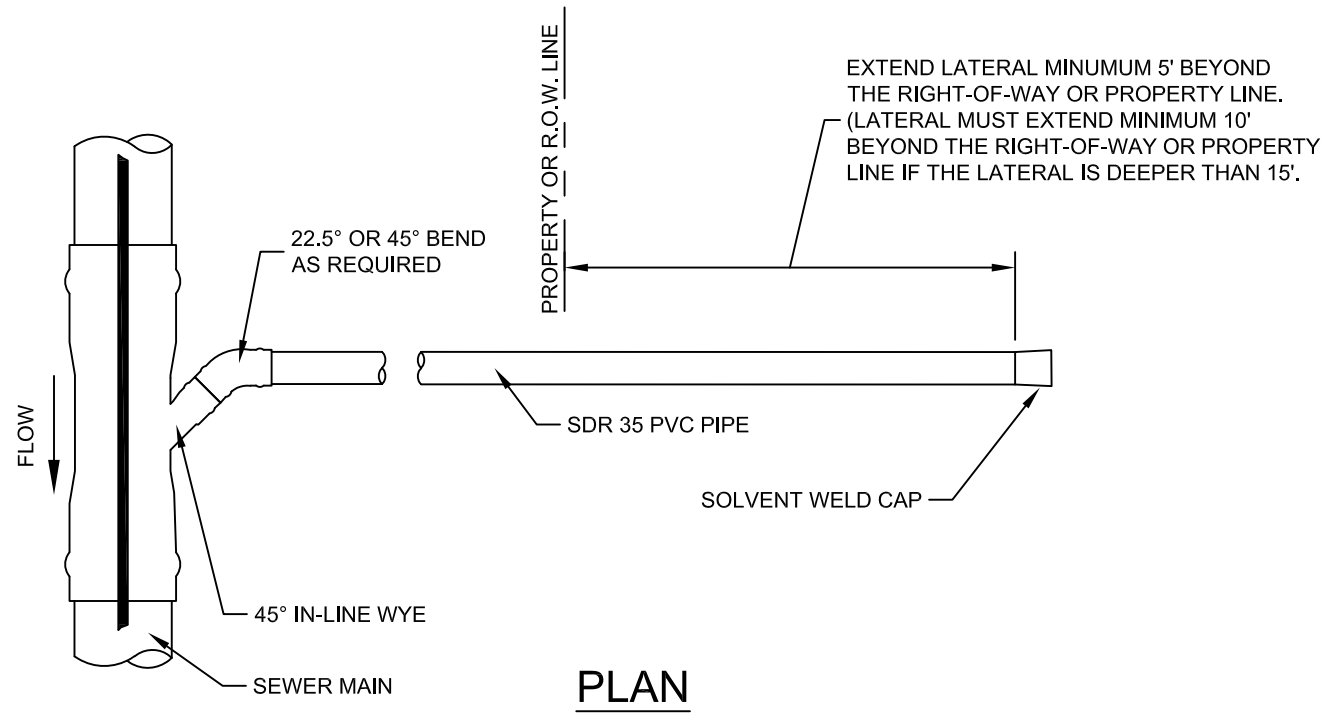

PLAN

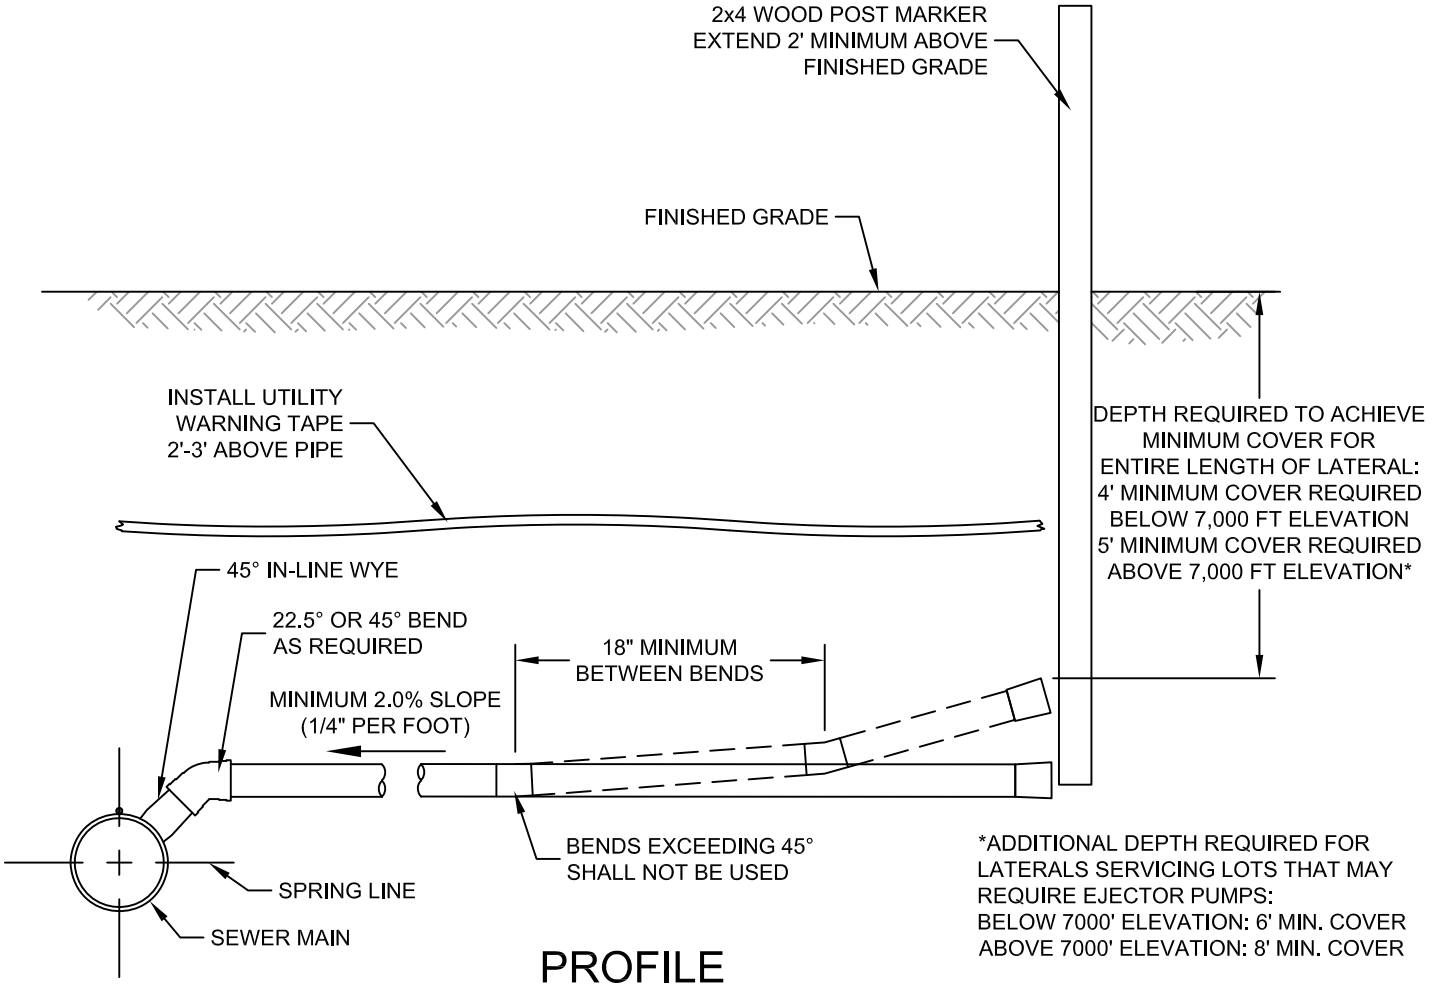

*ADDITIONAL DEPTH REQUIRED FOR LATERALS SERVICING LOTS THAT MAY REQUIRE EJECTOR PUMPS:
BELOW 7000' ELEVATION: 6' MIN. COVER
ABOVE 7000' ELEVATION: 8' MIN. COVER

PROFILE

Snyderville Basin Water Reclamation District	PRIVATE LATERAL STUB - GRAVITY FLOW PVC MAIN LINE TO PVC LATERAL LINE	STANDARD DETAIL LAT-01 Revision Date: 4/20/20