


### PROFILE VIEW

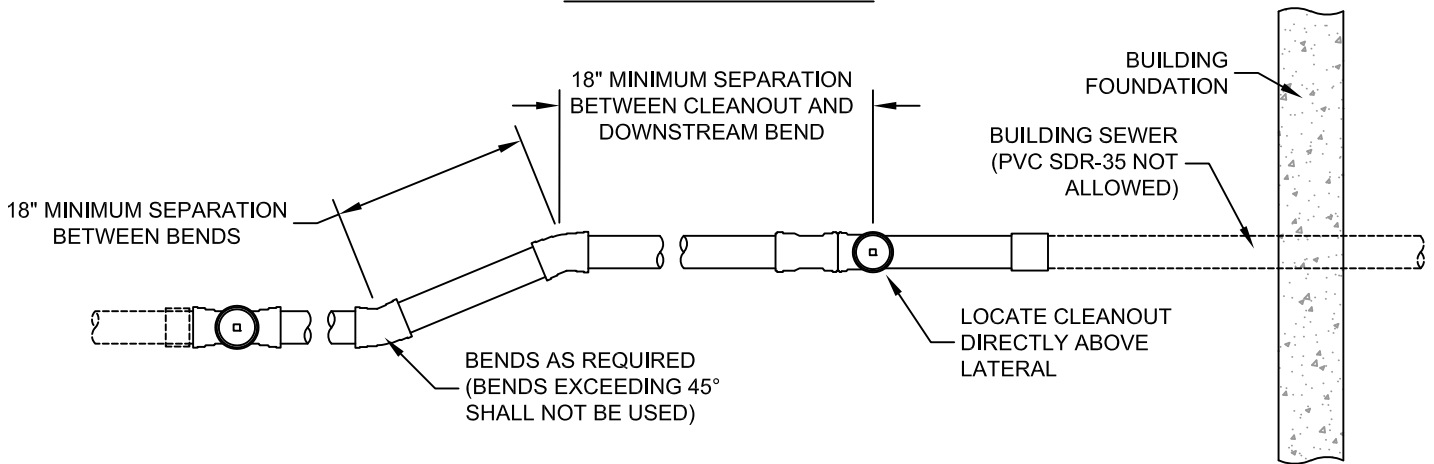

### PLAN VIEW

**NOTES:**

1. CLEANOUTS ARE REQUIRED ON PRIVATE LATERALS AT THE FOLLOWING LOCATIONS:
  - A: WITHIN 5 FEET OF THE BUILDING FOUNDATION
  - B: AT NO MORE THAN 100 FEET APART, MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT
2. BENDS EXCEEDING 45° SHALL NOT BE USED
3. FUSION WELD OR SOLVENT WELD FITTINGS AND JOINTS REQUIRED ON VERTICAL BENDS AND ON SLOPES GREATER THAN 3:1 (33%)
4. MAINTAIN 10' MINIMUM SEPARATION BETWEEN LATERAL AND ANY ADJACENT WATER MAIN LINE OR LATERAL.
5. SEPARATION FROM AN ADJACENT RETAINING WALL FACE SHALL MEET THE MINIMUM VERTICAL DEPTH REQUIREMENTS.



**Snyderville Basin Water  
Reclamation District**

## GRAVITY LATERAL STUB TO GRAVITY BUILDING CONNECTION

STANDARD DETAIL

**LAT-05**

Revision Date: 11/9/20