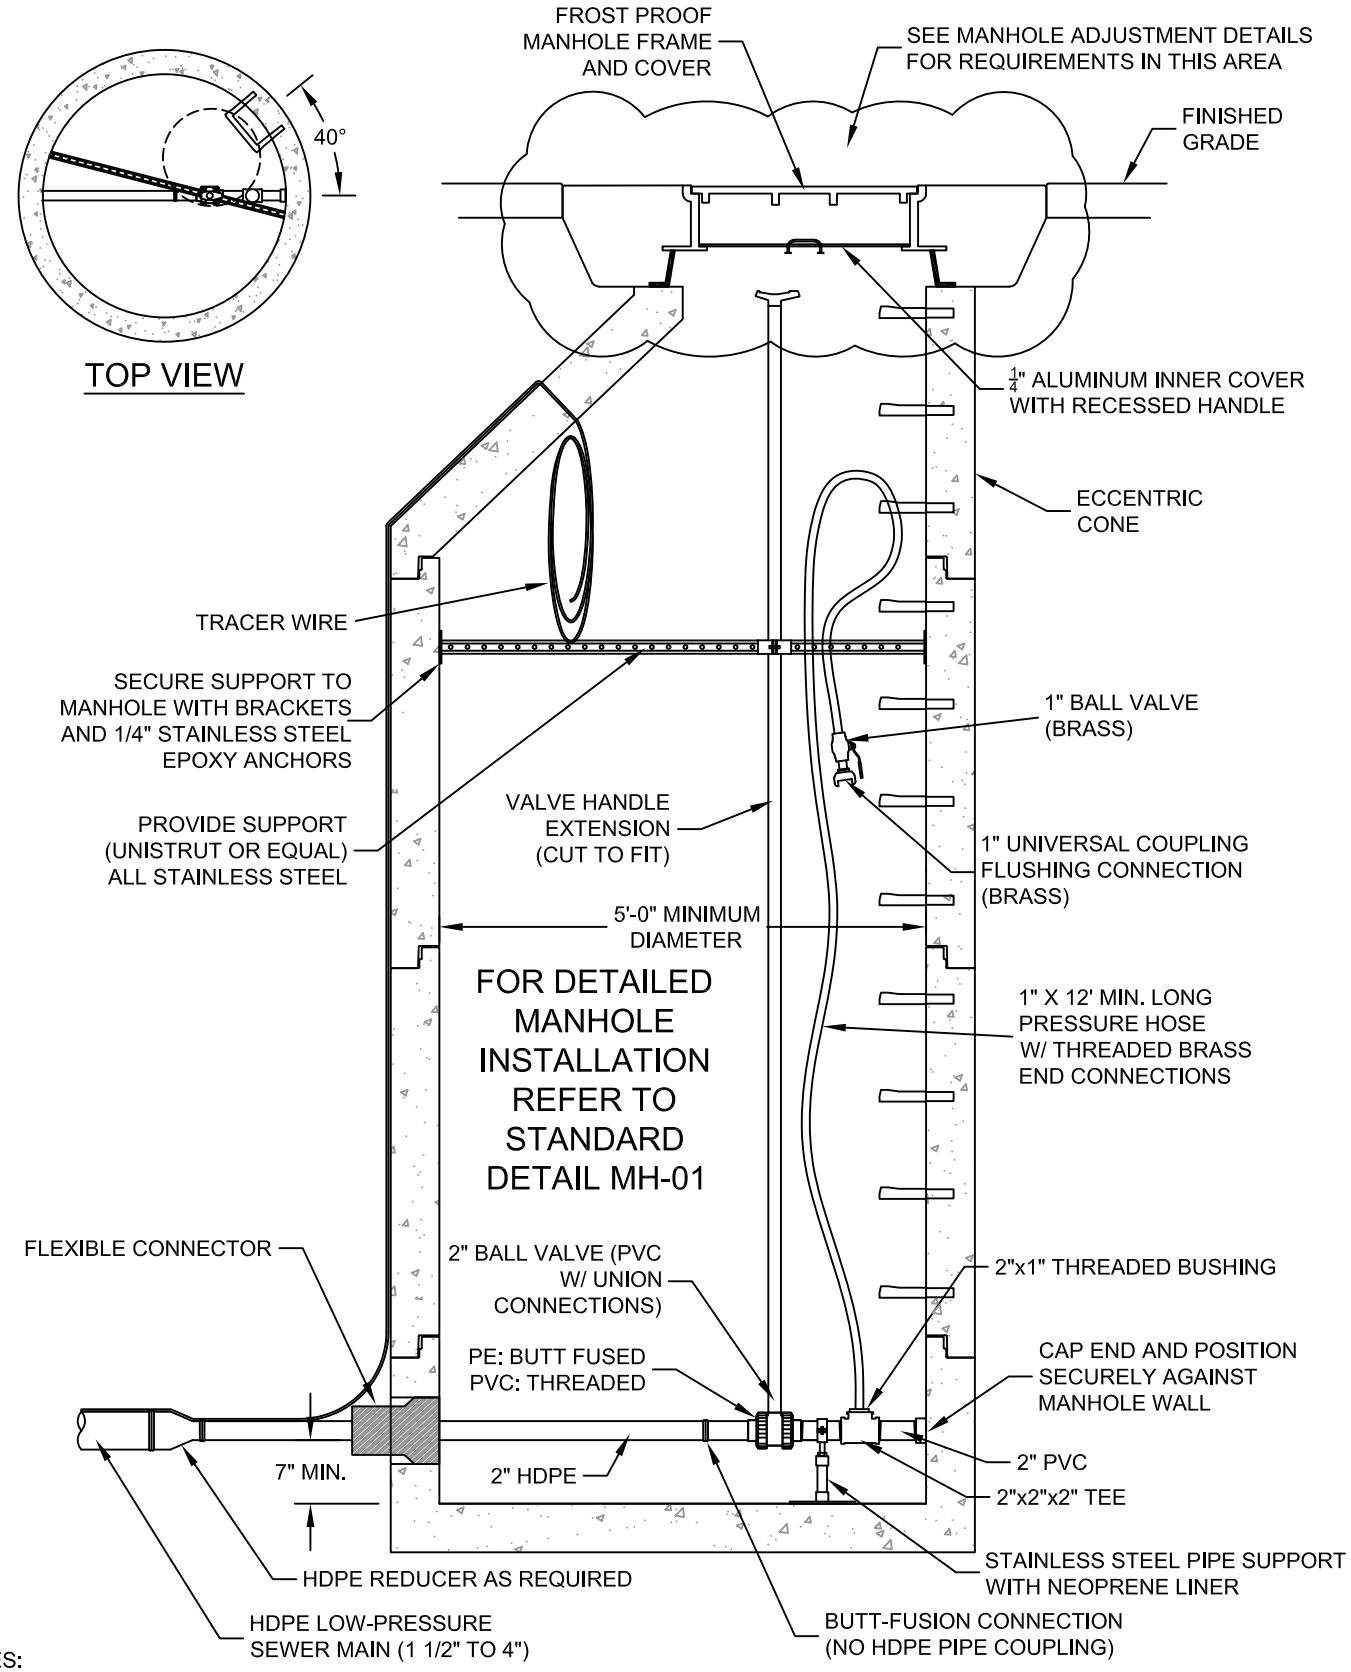

NOTES:

1. ALL HDPE JOINTS SHALL BE BUTT FUSED. ALL PVC PIPE AND FITTINGS SHALL BE SCH. 80 PVC WITH THREADED JOINTS
2. SECURE STAINLESS STEEL SUPPORT BASE PLATE TO FLOOR WITH 1/4" STAINLESS STEEL EPOXY ANCHORS.

Snyderville Basin Water Reclamation District

DEAD END LOW-PRESSURE FLUSHING CONNECTION

STANDARD DETAIL

LP-02

Revision Date: 2/23/21